
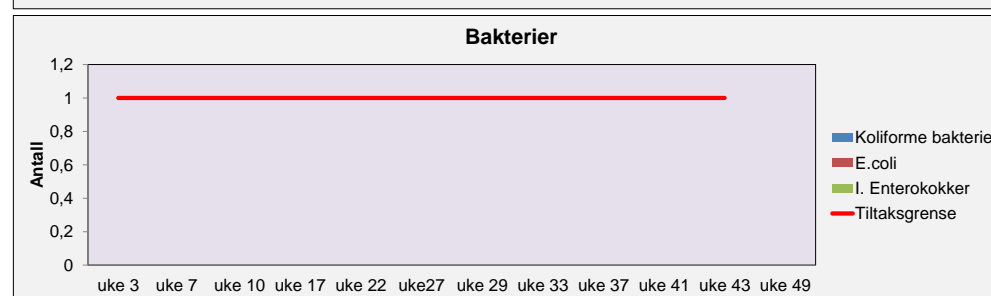
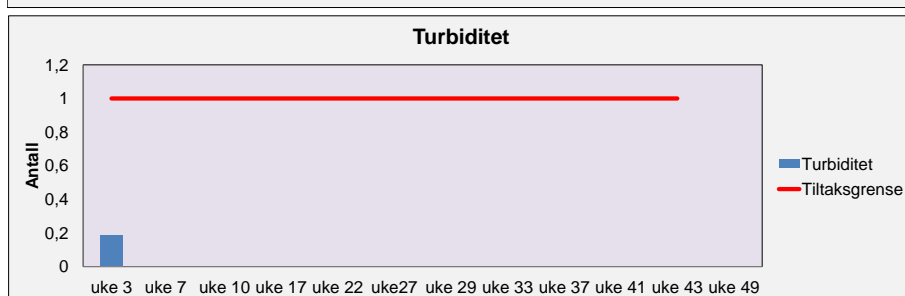
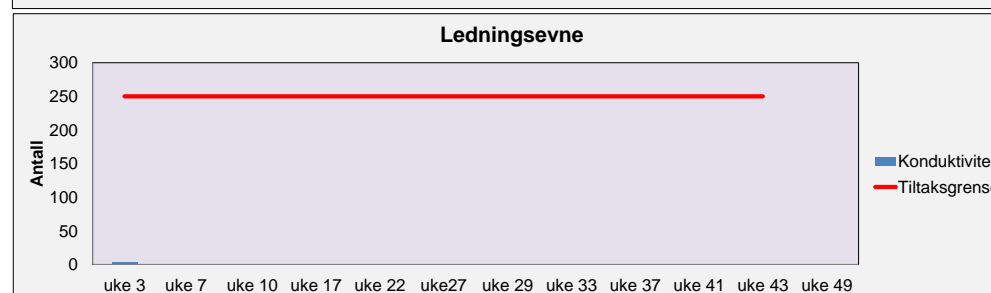
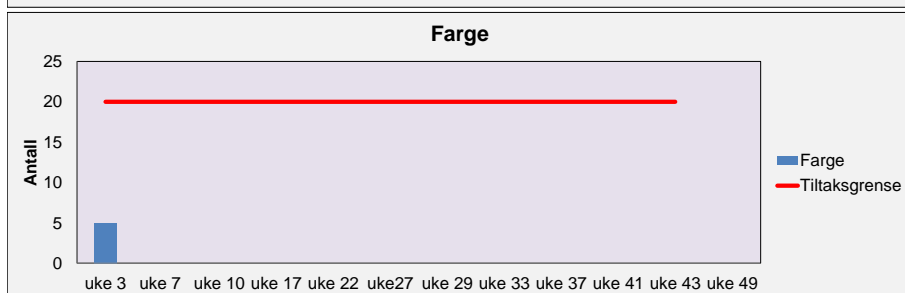
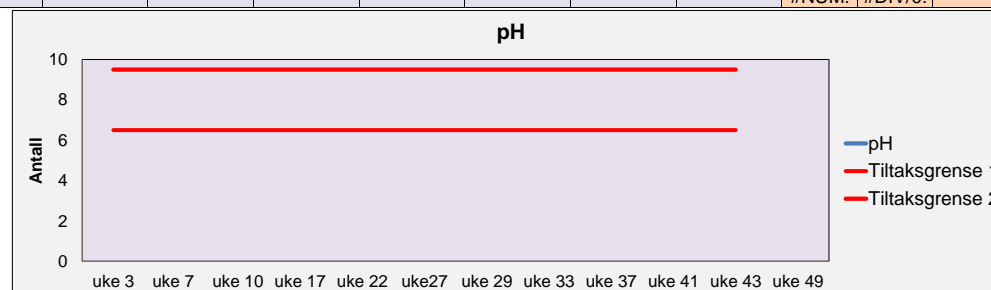


Analyse	Enhet	Tiltaksgrense	uke 3	uke 7	uke 10	uke 17	uke 22	uke27	uke 29	uke 33	uke 37	uke 41	uke 43	uke 49	Median	Gj.s	Min
			Dagbygg	Dagbygg	Hybel	Dagbygg	Hybel	Dagbygg	Dagbygg	Dagbygg	Hybel	Dagbygg	Hybel	Dagbygg			
Kimtall 22°C	Antall/ml	< 100	222												#NUM!	222,0	222,0
Koliforme bakterier	Antall/100 ml	< 1	0												#NUM!	0,0	0,0
E.coli	Antall/100 ml	< 1	0												#NUM!	0,0	0,0
I. Enterokokker	Antall/100 ml	< 1	0												#NUM!	0,0	0,0
pH	Surhetsgrad	ok innenfor 6,5 - 9,5	6,7												#NUM!	6,7	6,7
Farge	mg/l	< 20	5												#NUM!	5,0	5,0
Konduktivitet	mS/m ved 20°C	< 250	4,3												#NUM!	4,3	4,3
Turbiditet	FTU	< 1	0,19												#NUM!	0,2	0,2

Skal testes etter rengjøring/større vedlikehold:

Ammonium	mg/l	< 0,5													#NUM!	#DIV/0!	0
Jern	mg/l	< 0,2													#NUM!	#DIV/0!	0
Nitritt	mg/l	< 0,5													#NUM!	#DIV/0!	0
Aluminium	mg/l	< 0,2													#NUM!	#DIV/0!	0

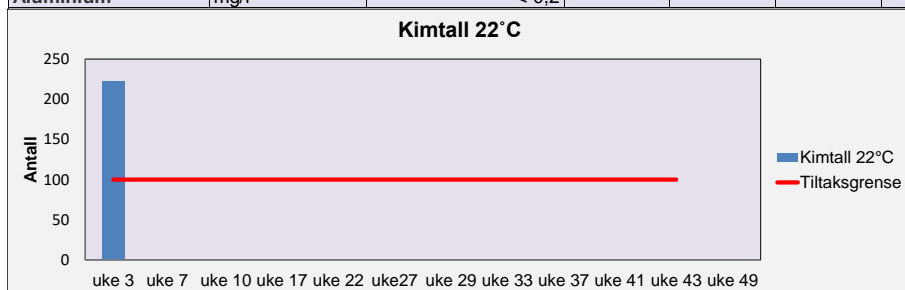

nn
Max
222,0
0,0
0,0
0,0
6,7
5,0
4,3
0,2
0
0
0
0

